

STERIL-AIRE®

*World Leaders for UVC
Protection of Museums,
Libraries, Archives
& Irreplaceable
Treasures*





Brochure for International use only.

How Steril-Aire Benefits Museums, Libraries, and Archives

INTERIOR ENVIRONMENT

Improved IAQ

- Air from AC System up to 99% free of microorganisms *
- Helps protect irreplaceable treasures from mould and fungi
- Reduction in distribution of airborne infections (flu etc) ***
- Partial pandemic protection ****
- Reduction in staff sickness and absenteeism **
- Partial protection against Legionella
- Reduction in VOCs and odours *

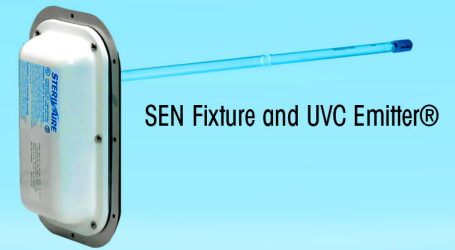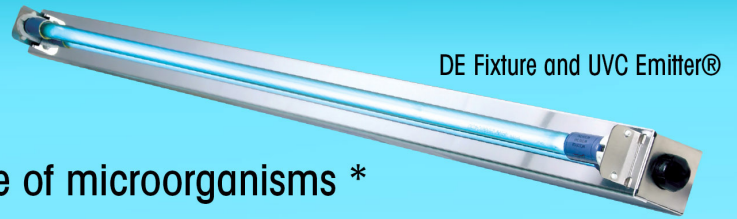

FACILITIES *****


Automatic coil cleaning

- Reduced AC maintenance
- Reduction of maintenance labour & chemical costs
- AC energy saving (10-20%)
- Reduction in carbon footprint
- Improved sustainability
- Coil Condensate Recovery/Recycling



Extension of equipment life:

- Coil
- Chiller

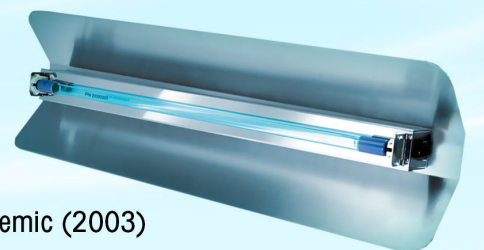

* Subject to UVC Dosage applied

** See Case Study: McGill University, Montreal, Canada

*** ASHRAE Airborne Infectious Diseases Position Document

**** Use of Steril-Aire UVC at Tan Tock Seng Hospital at height of SARS pandemic (2003)

***** See Case studies at www.steril-aire.com

Museums, Libraries, and Archives Use of Steril-Aire UVC



HVAC systems

- AHUs
- Fan-coils
- Splits
- Packaged Units
- Unit Ventilators
- Heat Wheels
- Cooling Towers


Locations

- Lobby
- Galleries
- Libraries
- Archives
- Preservation Workshops
- Classrooms
- Lecture Theaters
- Conference Rooms
- Cafeterias / Kitchens
- Ice Machines
- Administration Offices
- Restrooms
- Elevators
- Parking Structure Exhausts
- Gift Shops



Archival Mold Remediation

- Steril-Wand:
For hand-held mould remediation on delicate archival materials (Test first).


The Science of Steril-Aire UVC

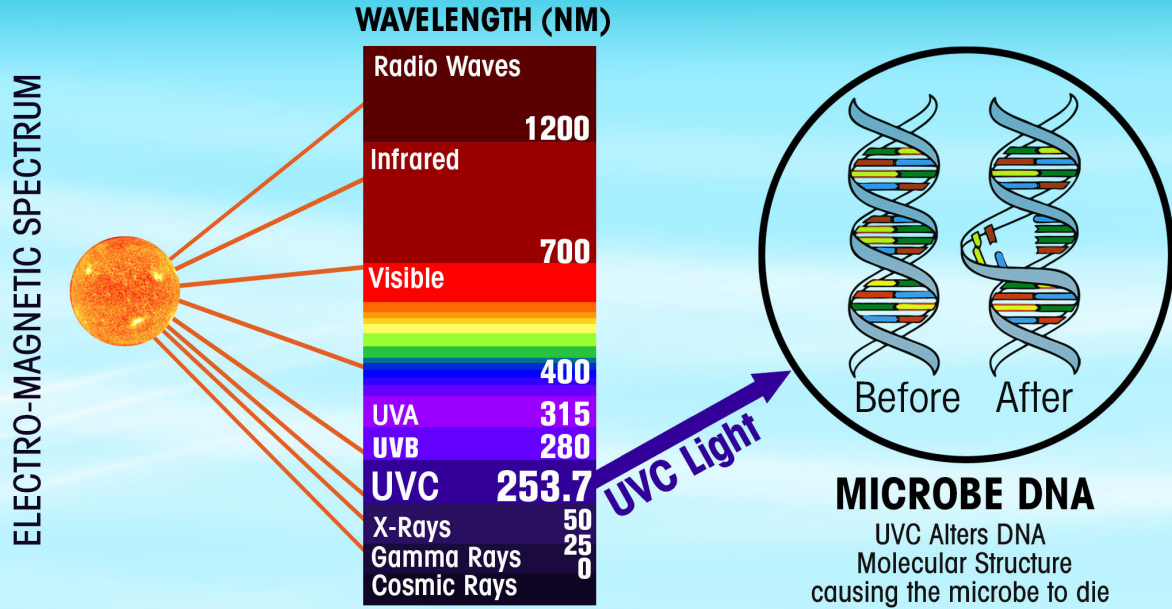

Air-Conditioning Cooling Coil

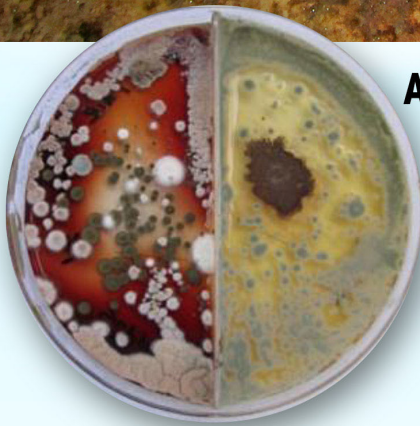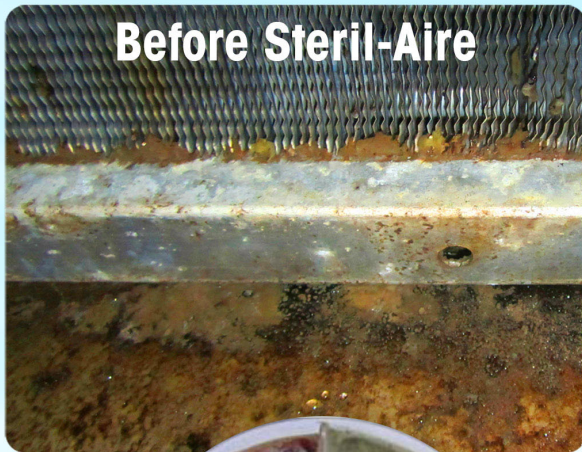

AIR BIO-TEST

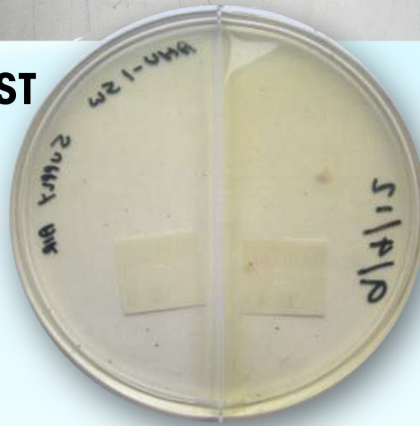

Before Steril-Aire

After Steril-Aire

Protection of Irreplaceable Artwork & Documents

Leonardo da Vinci Archive Endorsement




The Bibliotheca Ambrosiana (Ambrosiana Library) in Milan, Italy, installed Steril-Aire's UVC Emitters to protect Leonardo da Vinci's 1,119-page Atlantic Codex, the largest collection of Leonardo's drawings, embracing his thoughts and contributions to the arts and sciences for more than 40 years from 1478–1519.

The library-museum, which has guarded and preserved the Leonardo collection since 1637, is bringing thousands of drawings out of the vault and unbinding them for their first-ever public display in Milan and later in exhibitions all over the world.

"After extensive research, we determined that Steril-Aire's UVC technology offers the best option for preserving these 500-year-old documents against the potential ravages of mould and bacteria that travel through building air handling systems," said Giorgio Ricchebuono, President of the Cardinal Federico Borromeo Foundation. "The UVC devices provide a constant germicidal cleansing action to keep building air clean and free of harmful microbes."

Barbados Attorney General Protects Files and Records

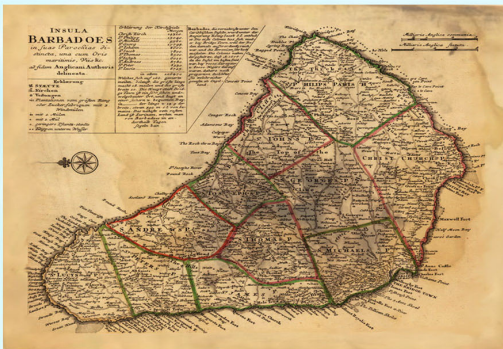


Prior to moving into new a new building, the Barbados Attorney General wanted all of their files decontaminated from a heavy case of mould. The highly confidential files (consisting of books and records), included multiple generations of birth, marriage and death certificates, and completely filled two large shipping containers.

Over a six month period, a team exposed each page of the archives to a pre-tested dose of Steril-Aire, and then wiped away the dead mould. To protect the new buildings, all furniture and equipment was also treated by Steril-Aire, before being installed in the building.

Steril-Aire UVC Products



Full catalogue at www.steril-aire.com

DE SERIES UVC EMITTER®

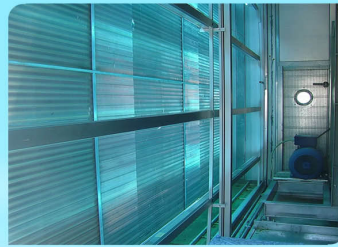


- For use in medium to large AHUs.
- Double-ended Emitters are mounted internally and fitted end-to-end to fit any size coil.
- Available in: 18", 24", 30", 36", 42", 62" inch lengths (46, 61, 76, 91, 107, 157 cm lengths).
- Universal power-supply. 110 to 277V - 50/60 Hz

SE SERIES UVC EMITTER®

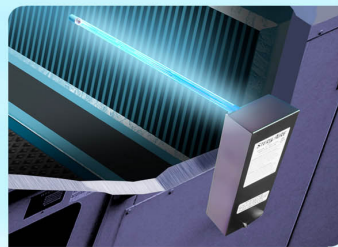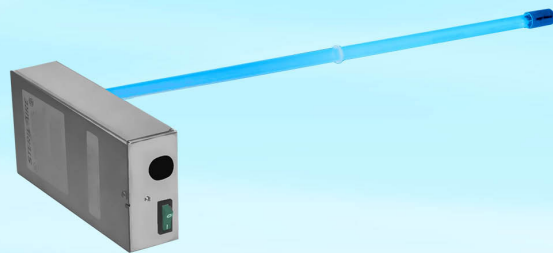




- For fan-coils, heat-pumps, unit ventilators, packaged AHUs, terminal units, and ducts.
- Mounted on exterior of AHU. Tube installed through a one-inch hole (2.54 cm) drilled through the AHU casing.
- Available in 12", 16", 20", 24", 30", 36", 42" inch lengths (30, 41, 51, 61, 91, 107 cm lengths).
- Universal power-supply: 110 to 277V- 50/60 Hz
- Also available as an internally mounted kit with 12" to 61" (30 to 155 cm) SE Emitter tubes.

SEN SERIES UVC EMITTER®

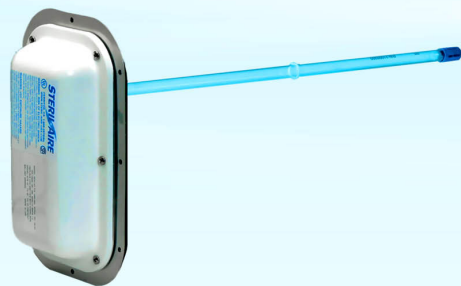


- For exteriors including roof-top units, AHUs, heat-pumps, fan-coils, terminal units, and ducts.
- NEMA 4 rated.
- Mounted on exterior of AHU. Tube installed through a one-inch hole (2.54 cm) drilled through the AHU casing.
- Available in 12", 16", 20", 24", 30", 36", 42", inch lengths (30, 41, 51, 61, 91, 107 cm lengths).
- Universal power-supply: 110 to 277V- 50/60 Hz

SE VO EMITTER® KIT FOR AIR HANDLERS

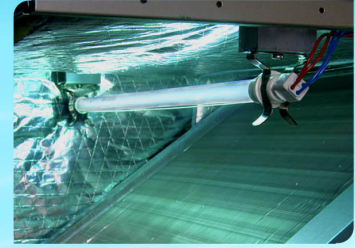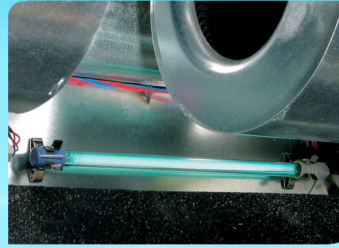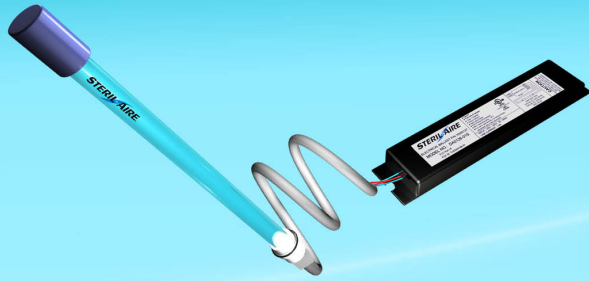



- Designed for air-handlers, fan coils, packaged systems, heat pumps and unit-ventilator systems.
- For coils larger than 15 inches high & up to 61 inches wide (38cm high & up to 155cm wide).
- The Kit includes a 110-277 V power supply (selection based on Emitter length) & one Mounting Kit selected from: 2 Short Hooks; 2 Small Spring Clips; Flat Plate Lamp Holder; Insert Emitter Holder, to fit most major brands.
- Available in: 12", 16", 20", 24", 30", 36", 42", 50" & 61" inch lengths (30, 41, 51, 61, 76, 91, 107, 127 & 155 cm).

SE HO EMITTER® KIT FOR UNITARY/SPLIT SYSTEMS

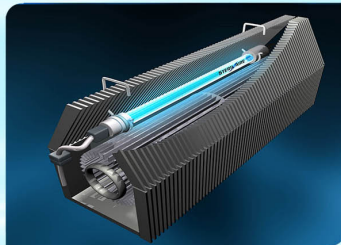

- Designed for air handlers below 5 tons, splits / mini splits, fan-coils, package units, PTAC units, & ceiling cassettes.
- For coils smaller than 15 inches high & 24 inches wide (38 cm high & 61 cm wide).
- The Kit includes a 110V 60Hz or 220V 50Hz power supply (please specify) plus Mounting Kit, selected from: 2 Short Hooks; 2 Small Spring Clips; Flat Plate Lamp Holder; Insert Emitter Holder.
- Available in: 7.5", 10", 16", 20", 24" inch lengths (19, 25, 41, 51, 61 cm).

STERIL-WAND® HANDHELD UNIT

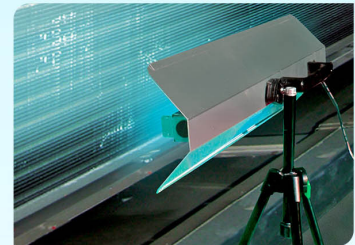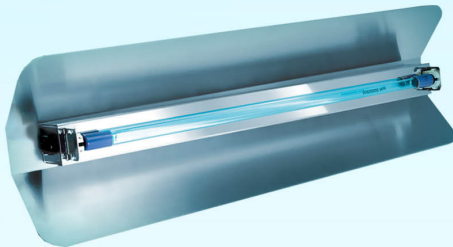

- For surface decontamination in labs, kitchens, classrooms, bathrooms, desks & telephones.
- For mould remediation on walls, floors, ceilings & for careful use on precious books and artifacts.
- Hand-held devices to be passed very slowly over surface or placed on tripod.
- Safety shield prevents direct exposure to UVC Energy.
- Operator's skin must be covered.

How Steril-Aire Works

The intended purpose of air-conditioning ("AC") is to enable people to work, play and live in buildings with economical, clean and cold air – sadly this is seldom the case. Because the pollution in the air is mainly invisible it is often ignored, yet the US EPA, World Health Organization and ASHRAE all warn of the potential health risks of AC systems. The health risks come from two main sources; 1: The biofilm (mould) that grows inside the AC system, fed by the condensate created when the warm air passes through the cold cooling coils, sending out mould, bacteria and their products (VOCs) into the air. 2: The bacteria that enter into the building via ducts, doors and windows, and the viruses and bacteria (coughs and sneezes) that enter with the people, all of which are distributed by the AC system. This leads to cold and flu outbreaks, sickness, absenteeism and a drop in productivity.

Case studies confirm that the high output Steril-Aire Emitters remove the biofilm from the AC coil and microbes from the air-stream making the air exiting the AC registers up to 99% free of virus, bacteria and mould, and thereby reducing sickness and absenteeism. Air-conditioning uses a lot of energy, often as much as 60% of the total building's energy, and contributes proportionally to the carbon footprint. The chiller and pumps normally consume 70% of the AC energy. The biofilm on the coil restricts airflow and reduces the heat transfer capability of the coil, resulting in warmer and humid air. This causes the occupants to lower the temperature settings on the thermostats, or the maintenance department to lower the chiller set point, causing the chiller to work more and use more energy.

(The heat conductivity of aluminium used in cooling coils is approximately 200 W/m.K while that of biofilm is approximately 0.2 W/m.K. Most coils are only cleaned once or twice a year and, due to the physical structure of the coil, the inside of the coil is seldom cleaned. Even after the coil is cleaned the biofilm starts re-growing immediately).

A typical case study example came from Steril-Aire's Singapore, GETC Green Team, that was asked to improve the air and energy efficiency of the AC system in the Singapore Parliament Building. The Green Team introduced the Steril-Aire UVC Emitter® into the AHUs, which resulted in improved heat transfer efficiency at the cooling coil, raising the chilled water set-point from 6.6°C to 8.5°C. The parameters (tonnage and chilled temperature) for the cutting-in and cutting-out of the chillers, were readjusted to 'stretch' the chillers to maximize chiller efficiency. After the fine-tuning process, the return chilled water temperature was raised from the previous 9.8°C to 13.9°C. As a result, the chilled water ΔT was increased from 3.2°C to 5.1°C. The overall chiller plant efficiency improved from 1.1 kW/ton to 0.86 kW/ton (an improvement of 21.8% in chiller plant efficiency), enabling the Singapore Parliament House to secure the Green Mark Gold Award.

Before Improvement				After Improvement (UVGI for AHUs, Resetting of Chiller Plant Control Parameters)			
Chilled Water Supply Temp	Chilled Water Return Temp	ΔT	Chiller Plant Efficiency	Chilled Water Supply Temp	Chilled Water Return Temp	ΔT	Chiller Plant Efficiency
6.6 °C	9.8 °C	3.2°C	1.1 kW/ton	8.5 °C	13.6 °C	5.1°C	0.86kW/ton

Data Showing Improvement in Chiller Plant Efficiency with Contribution from Clean Coils Installed with Steril-Aire UVC Emitters

USA HOMELAND SECURITY RESEARCH

Dose $\mu\text{W}\cdot\text{sec}/\text{cm}^2$ per watt

- STERIL-AIRE
- SANUVOX TECHNOLOGIES
- ULTRAVIOLET DEVICES
- NOVATRON
- LUMALIER
- DUST FREE
- ATLANTIC UV
- AMERICAN UV
- ABRACAIR LLC

Case Studies (www.steril-aire.com)

Industry UVC Acknowledgement: ASHRAE

- Director's Letter June 24th 2009
- Chapter 17 - 2012 ASHRAE Handbook (HVAC Systems and Equipment)
- Chapter 60 - 2011 ASHRAE Handbook (HVAC Applications)

Email: info@sterileair.com.au

Phone: 1300 4 STERILE

Web: www.sterileair.com.au